



DESIGN "V"(VERTICAL)

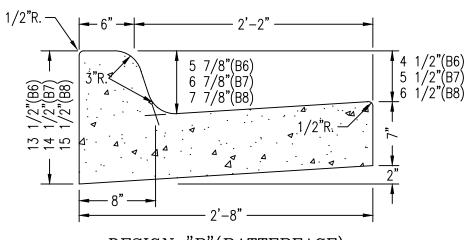

DESIGN "B"(BATTERFACE)

- CONCRETE MIX: MANUAL PLACEMENT— MN/DOT SPEC. 3F52, SLIP—FORM PLACEMENT—MN/DOT SPEC. 3F32.
- 2. PROVIDE 1/2" EXPANSION JOINT AT 300' MAXIMUM SPACING AND TO MATCH PAVEMENT EXPANSION JOINTS IN ADDITION TO EXPANSION JOINTS SHOWN ON OTHER DETAIL PLATES.
- 3. PROVIDE CONTRACTION JOINTS @ 9' MAXIMUM SPACING, SAW CUT 2" MINIMUM DEPTH.
- 4. ALL CONCRETE CURB & GUTTER SHALL BE PLACED ON A MINIMUM OF A 4" AGGREGATE BASE.
- 5. SILL REQUIRED FOR DESIGN "V" AND "B", WHEREVER SIDEWALK ABUTS CURB. SEE S.D.P. 2-02.

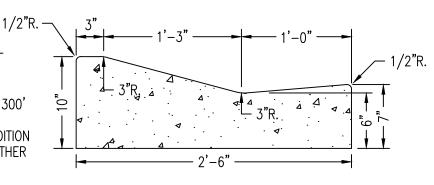


DESIGN "D"(DRIVEOVER)

DEPARTMENT OF PUBLIC WORKS CITY OF ROCHESTER, MINNESOTA

CONCRETE CURB & GUTTER

Λ				
Was I Molson Feel W. Frence				
ASST. CITY ENGINEER		DIRECTOR		
SHT 1 OF 1 SHTS	DATE 3/2	REVISED 3/18	PLATE NO. 2-01	REV. G

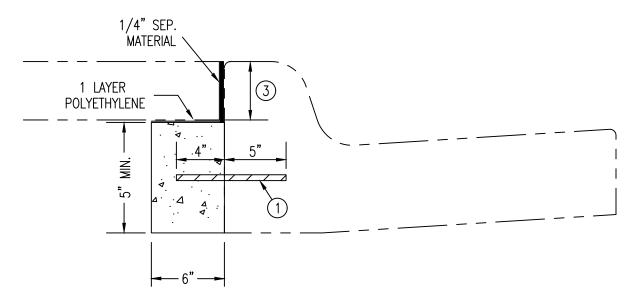

MODIFIED B624 CURB & GUTTER
MODIFIED V624 CURB & GUTTER (SIMILAR)

## NOTES

- 1) TIE SILL AT 3'-0" CENTERS WITH 9" x NO. 4 REINFORCING BARS OR POUR INTEGRALLY WITH CURB.
- 2. SILL SHALL BE INSTALLED ON ALL SIDEWALK LESS THAN 6" THICK, ABUTTING CURB & GUTTER.
- (3) DIMENSION TO BE SAME AS SIDEWALK THICKNESS, 5" MINIMUM.

DEPARTMENT OF PUBLIC WORKS CITY OF ROCHESTER, MINNESOTA


CONCRETE SILL

Din S. Dull
CITY ENGINEER

SHT 1 OF 1 SHTS


DATE REVISED | PLATE 4/15/22 | 2-

PLATE NO. | REV. | 2-02 | G

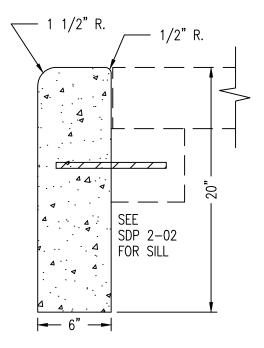

# STRAIGHT CURB U-1A


USE WHERE SIDEWALK EXISTS AND ON CURVES

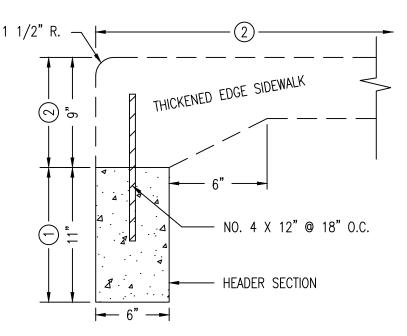

CURB & SIDEWALK U-2A

#### NOTES

- 1) INCLUDED IN PAYMENT FOR U-2A CURB PER LINEAL FOOT.
- 2 INCLUDED IN PAYMENT FOR SIDEWALK CONSTRUCTION PER SQUARE FOOT.
- 3. THESE DETAILS SHALL ONLY
  BE USED FOR RESTORATION
  OR PARTIAL RECONSTRUCTION
  WORK. NEW CONSTRUCTION
  SHALL USE CURB & GUTTER
  PER S.D.P. 2-01 OR CURB
  INTEGRAL TO CONCRETE
  PAVEMENT.

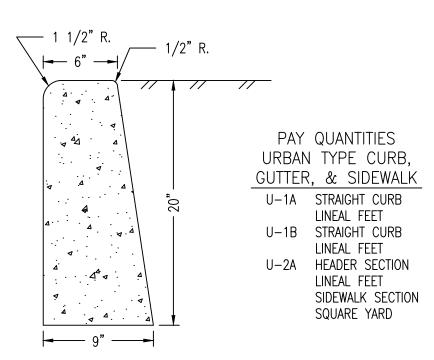

### STRAIGHT CURB U-1B

USE WHEN THERE IS NO SIDEWALK AND CURB & GUTTER IS NOT DESIRABLE

DEPARTMENT OF PUBLIC WORKS CITY OF ROCHESTER, MINNESOTA


URBAN TYPE CURB AND SIDEWALK

/20/17

REV.

2 - 03

ASST. CITY ENGINEER DIRECTOR
SHT 1 OF 1 SHTS 1/20/17 2 0.7

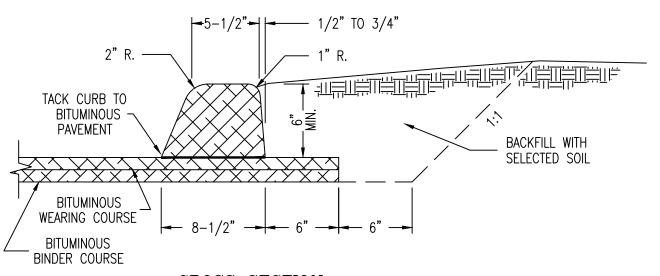

### CROSS SECTION

### NOTE

VOLUME OF CURB = 0.288 CUBIC FEET PER LINEAL FOOT. WEIGHT OF CURB = 21.12 TONS PER 1000 LINEAL FEET.

DEPARTMENT OF PUBLIC WORKS CITY OF ROCHESTER, MINNESOTA

BITUMINOUS CURB


ASST. CITY ENGINEER DIRECTOR


CUT. 1 OF 1 SUTS DATE REVISED PLATE NO. REV.

SHT 1 OF 1 SHTS  $\frac{DATE}{3}$ 

 $\frac{3}{22}/06 = \frac{12}{2}$ 

2-04 A

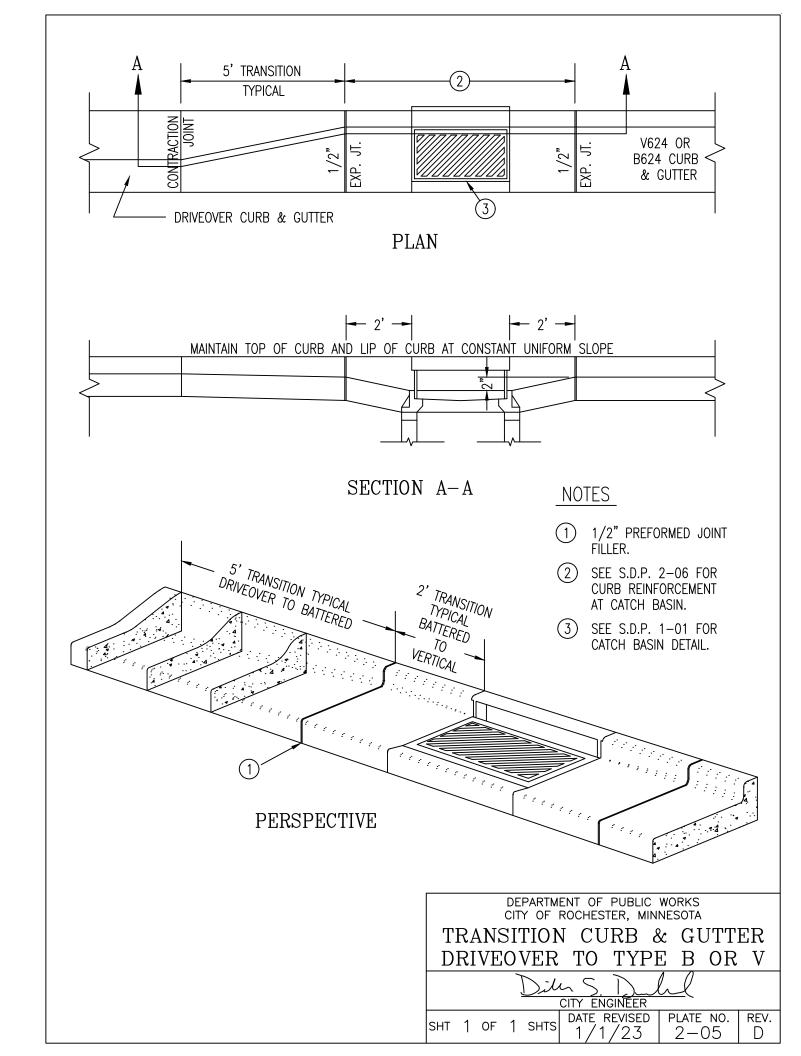

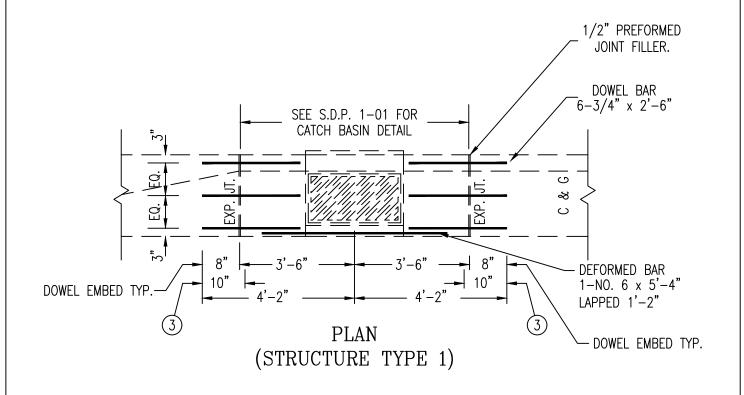


- DOWEL BARS SHALL BE PER MN/DOT SPEC. 3302 (EPOXY COATED).
- 2. DEFORMED BAR SHALL BE PER MN/DOT SPEC. 3301 (EPOXY COATED).
- (3) COAT THE DOWEL BARS WITH A THIN UNIFORM COATING OF AN APPROVED FORM COATING MATERIAL MEETING MN/DOT SPEC. 3902 NOT MORE THAN THAN ONE HOUR BEFORE COVERING WITH CONCRETE, OR WRAP WITH TEFLON TAPE.


DEPARTMENT OF PUBLIC WORKS
CITY OF ROCHESTER, MINNESOTA


CURB & GUTTER REINFORCEMENT
AT CATCH BASINS


Long Long Long Long Director


SHT 1 OF 1 SHTS DATE REVISED PLATE NO. REV.
1/20/17 2-06 E

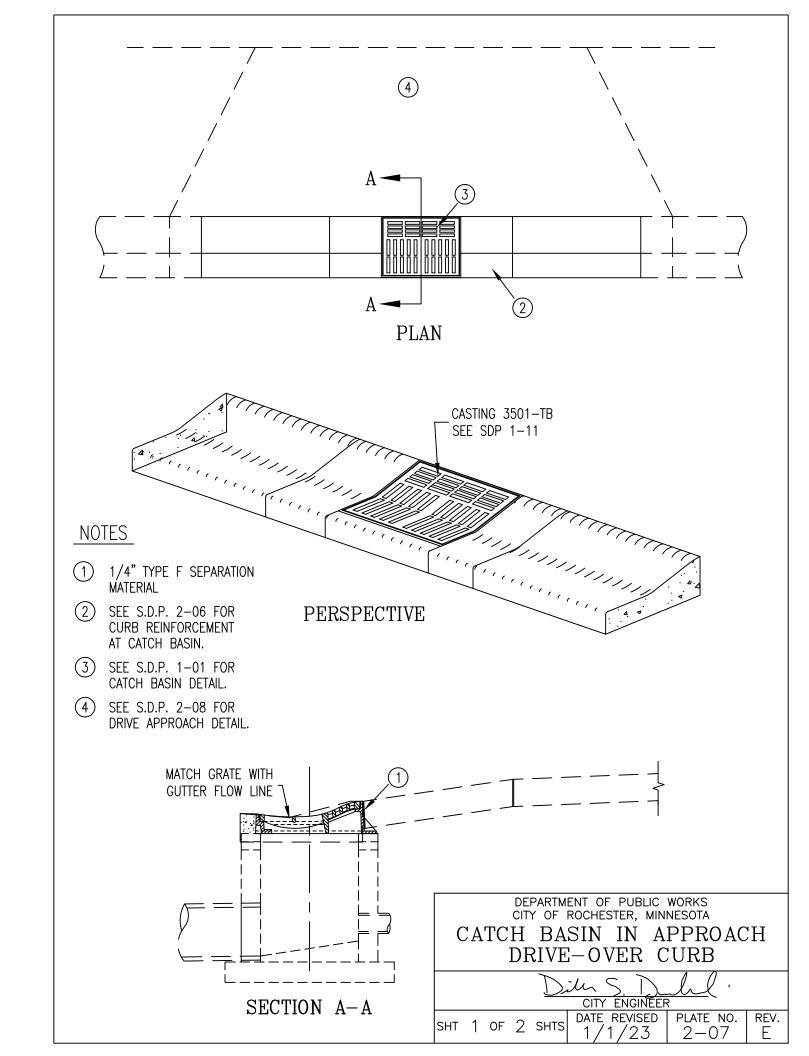


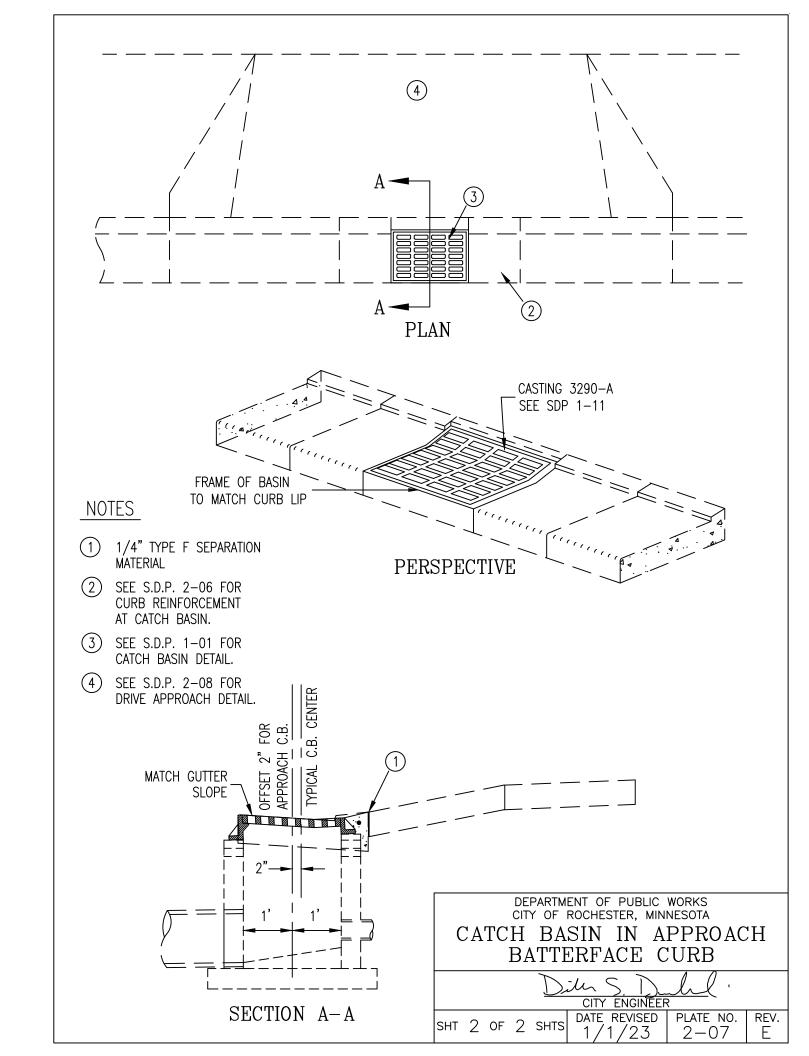


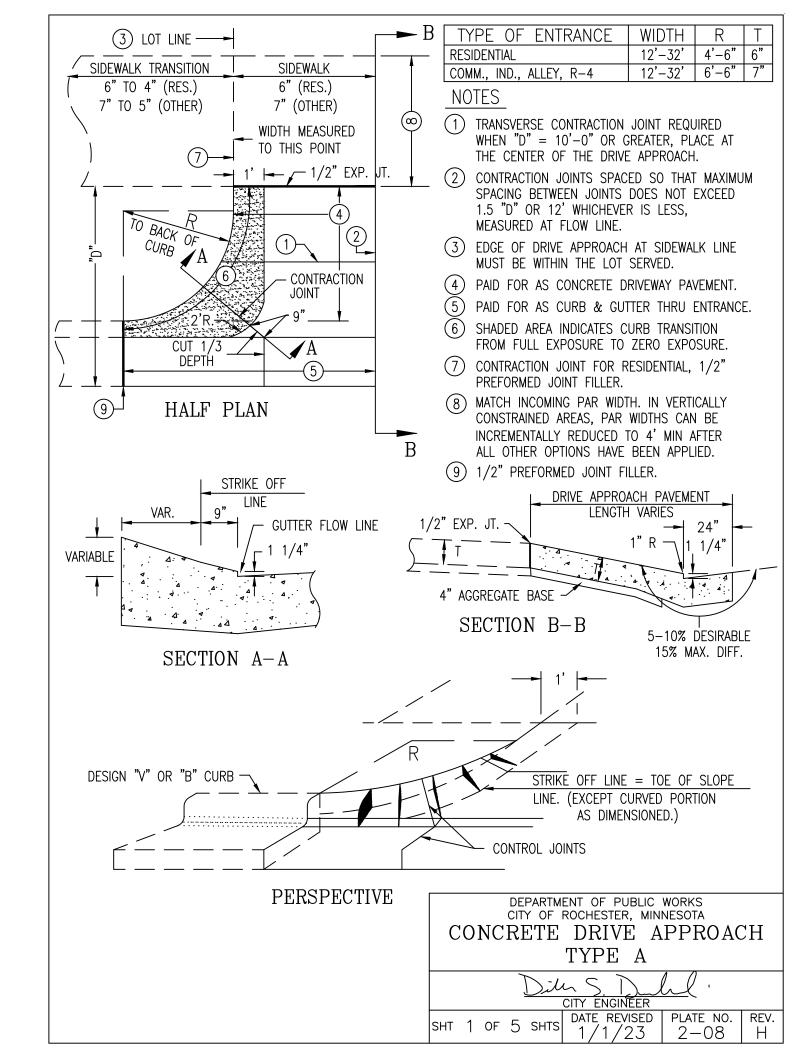


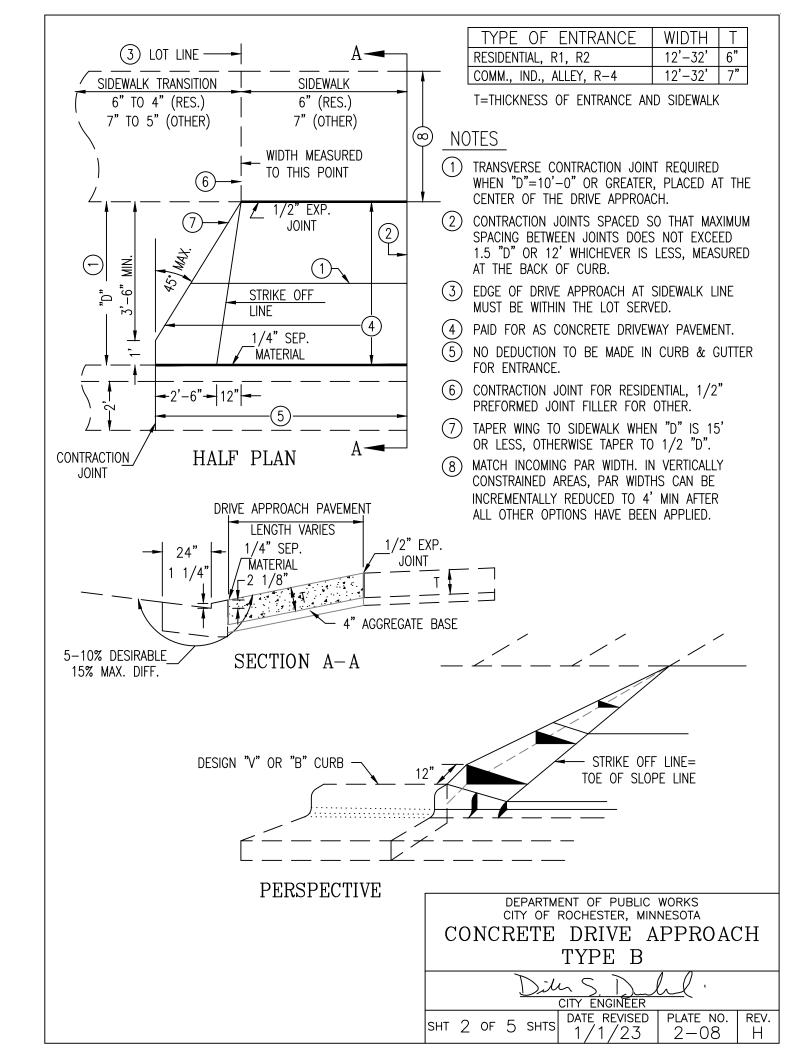


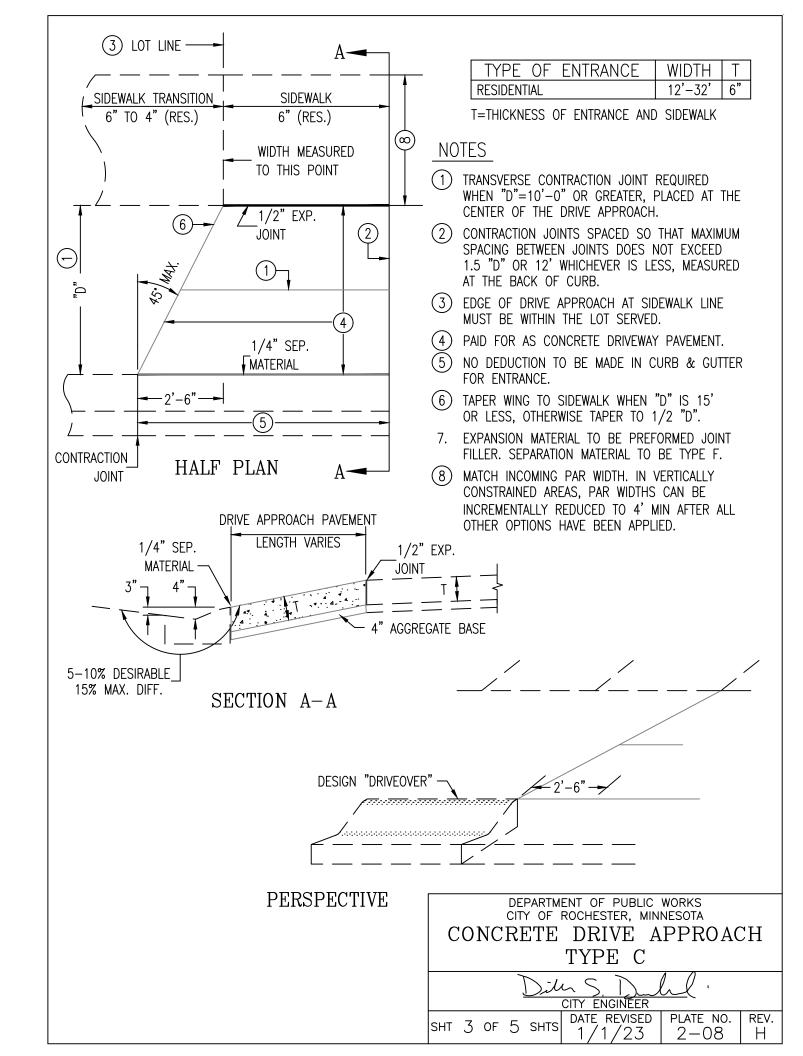

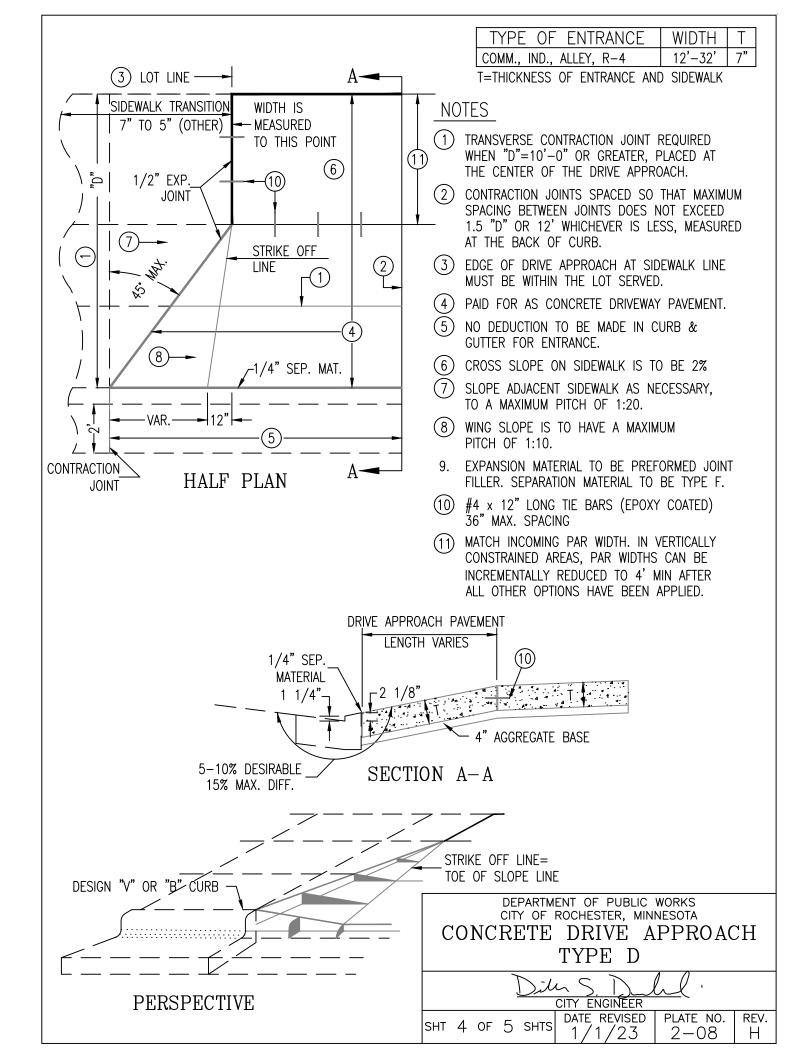

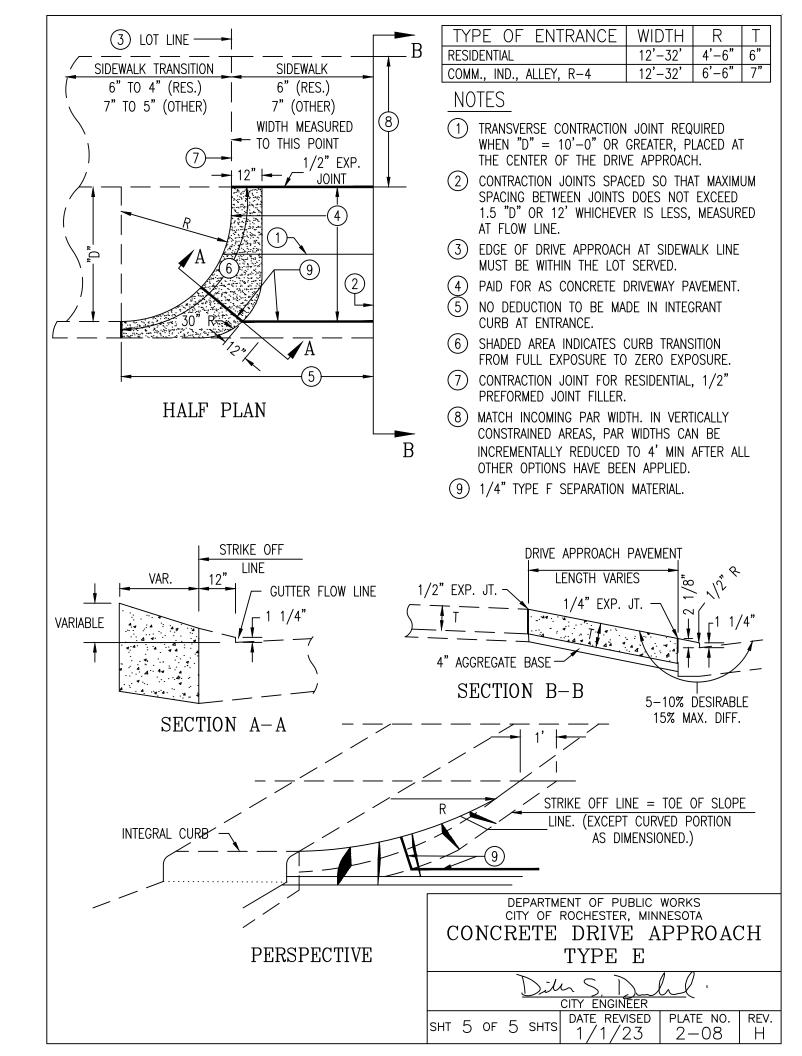

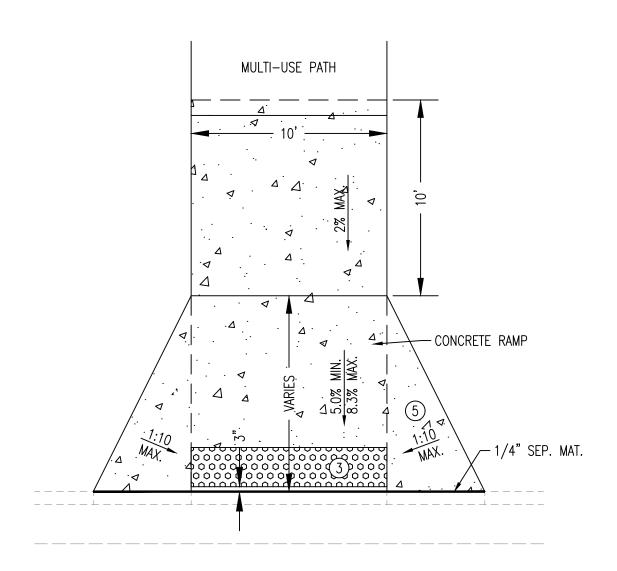



- 1. DETAIL COMPLIES WITH THE AMERICANS WITH DISABILITIES ACT (ADA) REQUIREMENTS.
- 2. SEE MN/DOT STANDARD PLAN 5-297.250 PEDESTRIAN CURB RAMP DETAILS
- (3) IF RAMP IS PAID BY SQ. FT. THEN DETECTABLE WARNING AREA IS PAID IN ADDITION TO RAMP AREA.
- 4. RAMP THICKNESS IS TO BE MINIMUM 6" CONCRETE—MN/DOT SPEC. MIX 3F52 WITH A MINIMUM OF 4" AGGREGATE BASE (INCIDENTAL).
- (5) CONSTRUCT WINGS IN WALKABLE SURFACE AREAS.

DEPARTMENT OF PUBLIC WORKS CITY OF ROCHESTER, MINNESOTA


MULTI-USE PATH CURB RAMP


REV.


0

CITY ENGINEER

SHT 1 OF 1 SHTS DATE REVISED PLATE NO. 1/26/24 2-09

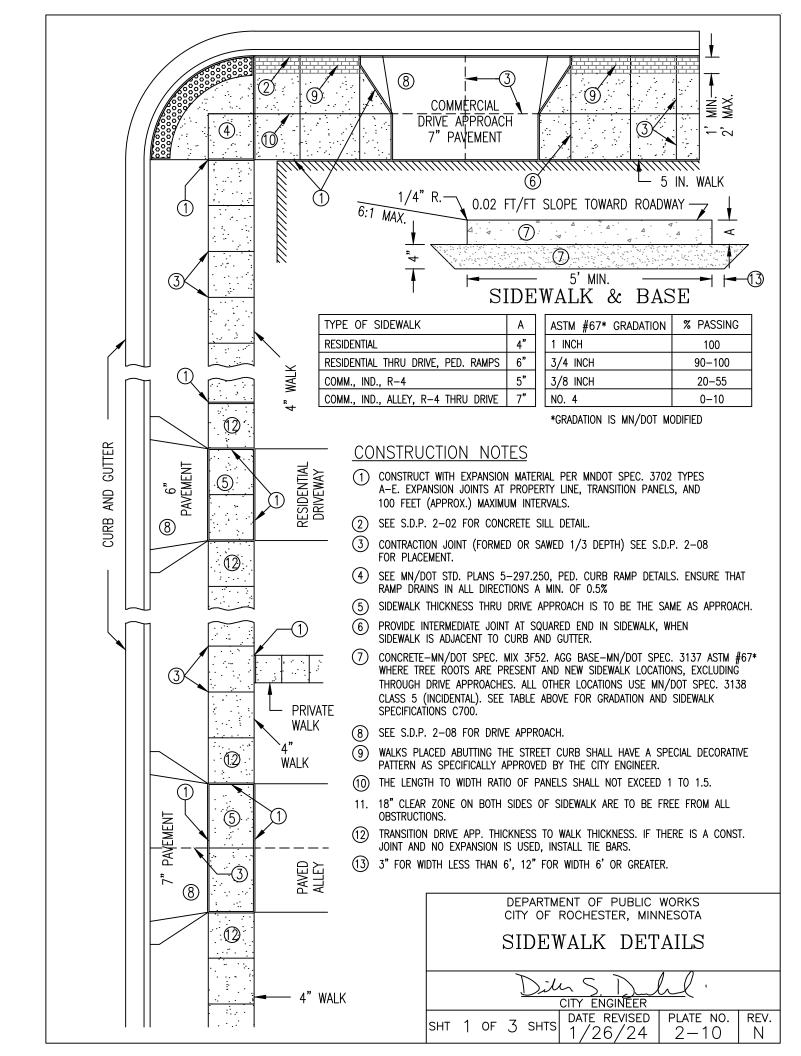


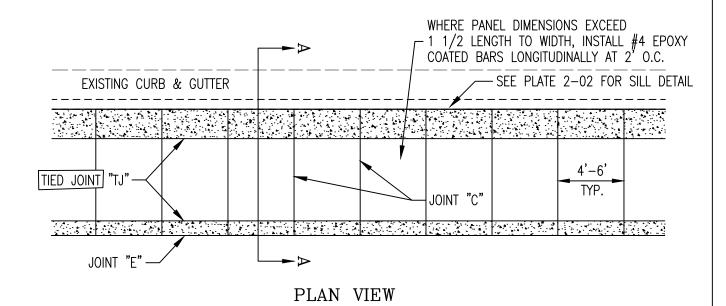


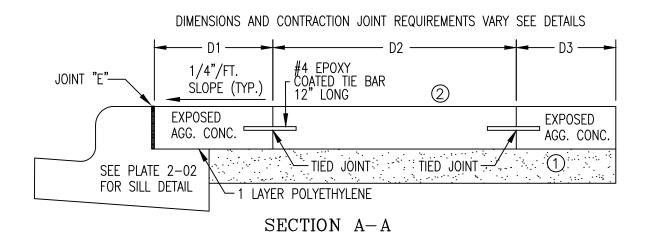


### CONSTRUCTION NOTES


- 1 PLACE 4" AGGREGATE BASE BELOW SLAB (INCIDENTAL)
- (2) CONCRETE SURFACE SHALL BE BROOM FINISHED
- 3. TIE ALL JOINTS BETWEEN EXPOSED AGGREGATE AND BROOM FINISH CONCRETE, TRANSVERSE AND LONGITUDINAL JOINTS (INCIDENTAL).
- 4. SEAL JOINTS WITH APPROVED FILLER AND SILICONE JOINT AND CRACK SEALER MEETING MN/DOT SPEC 3722 (INCIDENTAL).

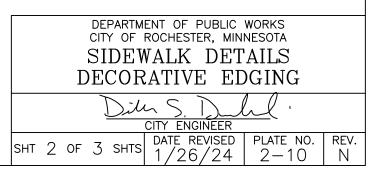

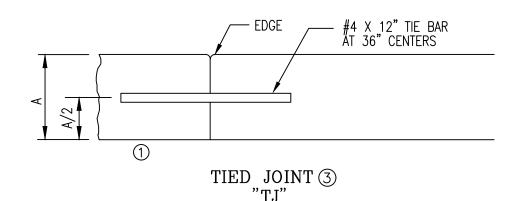


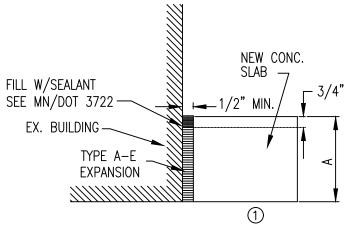

FOR USE AROUND FIXED OBJECTS AND BACK OF CURB EX. BUILDINGS, LIGHTS, HYDRANTS EXPANSION JOINT "E"




FOR USE IN CONCRETE SLABS EX. SIDEWALK, DRIVEWAYS EXPANSION JOINT "E"

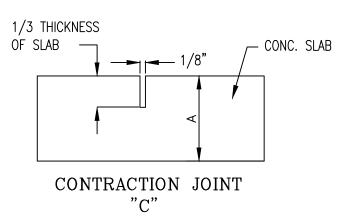

# CONSTRUCTION NOTES


- (1) PLACE 4" AGGREGATE BASE BELOW SLAB (INCIDENTAL)
- CONCRETE SURFACE SHALL BE BROOM FINISHED
- TIE ALL JOINTS BETWEEN EXPOSED AGGREGATE AND BROOM FINISH CONCRETE, TRANSVERSE AND LONGITUDINAL JOINTS (INCIDENTAL).
- CONSTRUCT JOINTS WITH APPROVED EXPANSION MATERIAL PER MNDOT TYPE A-E EXPANSION AND SEAL JOINTS WITH SILICONE JOINT AND CRACK SEALER MEETING MN/DOT SPEC 3722 (INCIDENTAL).

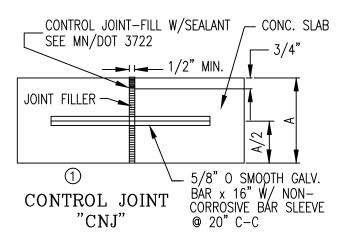


DEPARTMENT OF PUBLIC WORKS CITY OF ROCHESTER, MINNESOTA SIDEWALK DETAILS

CITY ENGINEER DATE REVISED PLATE NO. REV. SHT 3 OF 3 SHTS ′26/24 2 - 10

Ν

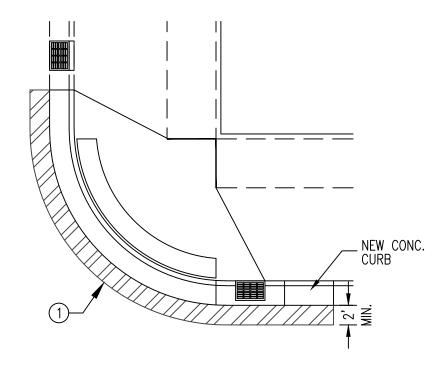

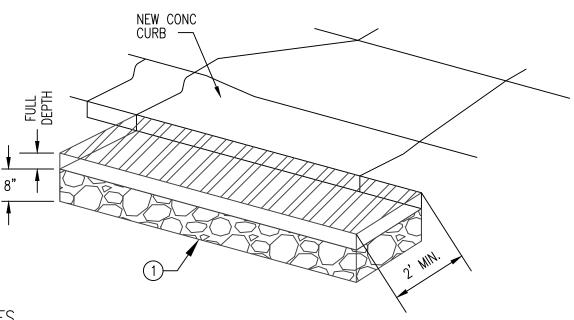

- (1) THE CONTRACTOR IS RESPONSIBLE FOR SAW CUTTING THE BITUMINOUS PAVEMENT FULL DEPTH A MIN OF 2' FROM NEW LIP OF CURB. CONTRACTOR IS ALSO RESPONSIBLE FOR PLACING AND COMPACTING AGGREGATE BASE.
- 2. THE CONTRACTOR IS RESPONSIBLE TO REMOVE ALL DEBRIS FROM TRENCH AREA, INCLUDING EXCESS CONCRETE, FORMWORK, SPIKES, ETC.
- 3. THE CITY WILL BE RESPONSIBLE FOR PLACING AND COMPACTING THE BITUMINOUS MIX FOR DRIVEWAY REPLACEMENTS, AS SHOWN OR STATED IN CITY BID PROJECTS, OR AS DIRECTED BY THE CITY ENGINEER.

DEPARTMENT OF PUBLIC WORKS CITY OF ROCHESTER, MINNESOTA

BITUMINOUS PATCH FOR CONC. CURB REPLACEMENT

CITY ENGINEER

DATE REVISED | PLATE I

SHT 1 OF 1 SHTS DATE REVISED PLATE NO. REV. 1/1/23 2-11 B

#### SIDEWALK REPAIR

SIDEWALK REPAIRS ARE REQUIRED BY THE CITY FOR HORIZONTAL AND VERTICAL DISPLACEMENT 1/4" OR GREATER AND FOR SUNKEN OR RAISED SIDEWALK PANELS EXCEEDING 1" FROM ORIGINAL GRADE. GENERAL SURFACE DETERIORATION AND OTHER CONDITIONS MAY ALSO REQUIRE SIDEWALK REPAIRS.


ALIGN REPLACEMENT SECTIONS PARALLEL OR PERPENDICULAR TO EXISTING JOINTS TO MAXIMUM EXTENTS PRACTICABLE.

REPLACE ALL JOINT LINES PER EXISTING JOINT PATTERNS.

#### GRINDING OR HORIZONTAL CUTTING


ANY DISPLACEMENT OF MORE THAN 1/4" WILL REQUIRE A RAMP OF 1:12 (8.3%)


GRINDING REPAIR SECTION SHALL NOT EXCEED 1" VERTICALLY.

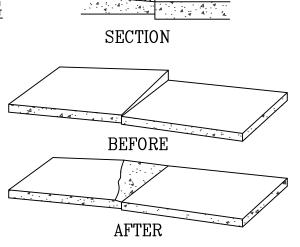



#### SLAB-JACKING


SAND, MUD OR POLY—JACKING IS RECOMMENDED AS A CORRECTIVE MEASURE WHEN THE SIDEWALK IS SUNKEN BY MORE THAN 1/4". CARE SHOULD BE TAKEN TO IDENTIFY THE CAUSE OF THE SETTLEMENT AND TO ENSURE THAT THE ISSUE HAS BEEN ADDRESSED.







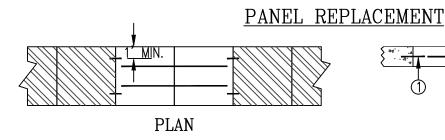



- ① DRILL & GROUT 12" NO. 4 EPOXY COATED TIE BARS.
- ② SUPPLEMENTAL EPOXY COATED REINFORCEMENT NO. 4 BAR IS REQUIRED FOR REPAIRS OF 3 PANELS OR LESS.
- 3. SAW CUT CONCRETE REMOVAL WALK FULL DEPTH.
- 4. SEE STANDARD PLATE 2-10 FOR FURTHER INFORMATION.
- 5. DRILL & GROUT TIE BARS, TIE BARS, AND SUPPLEMENTAL REINFORCEMENT BARS SHALL BE INCIDENTAL TO PANEL REPLACEMENT.

DEPARTMENT OF PUBLIC WORKS CITY OF ROCHESTER, MINNESOTA

#### SIDEWALK REPAIRS

CITY ENGINEER

DATE REVISED PLATE NO.

SHT 1 OF 1 SHTS

 $1/23 \mid 2-12$ 

REV.